


# Notification Zone Drawing

## ROWE 01N-65W-26

NE1/4 NW1/4, SECTION 26, TOWNSHIP 1 NORTH, RANGE 65 WEST OF THE 6TH PRINCIPAL MERIDIAN

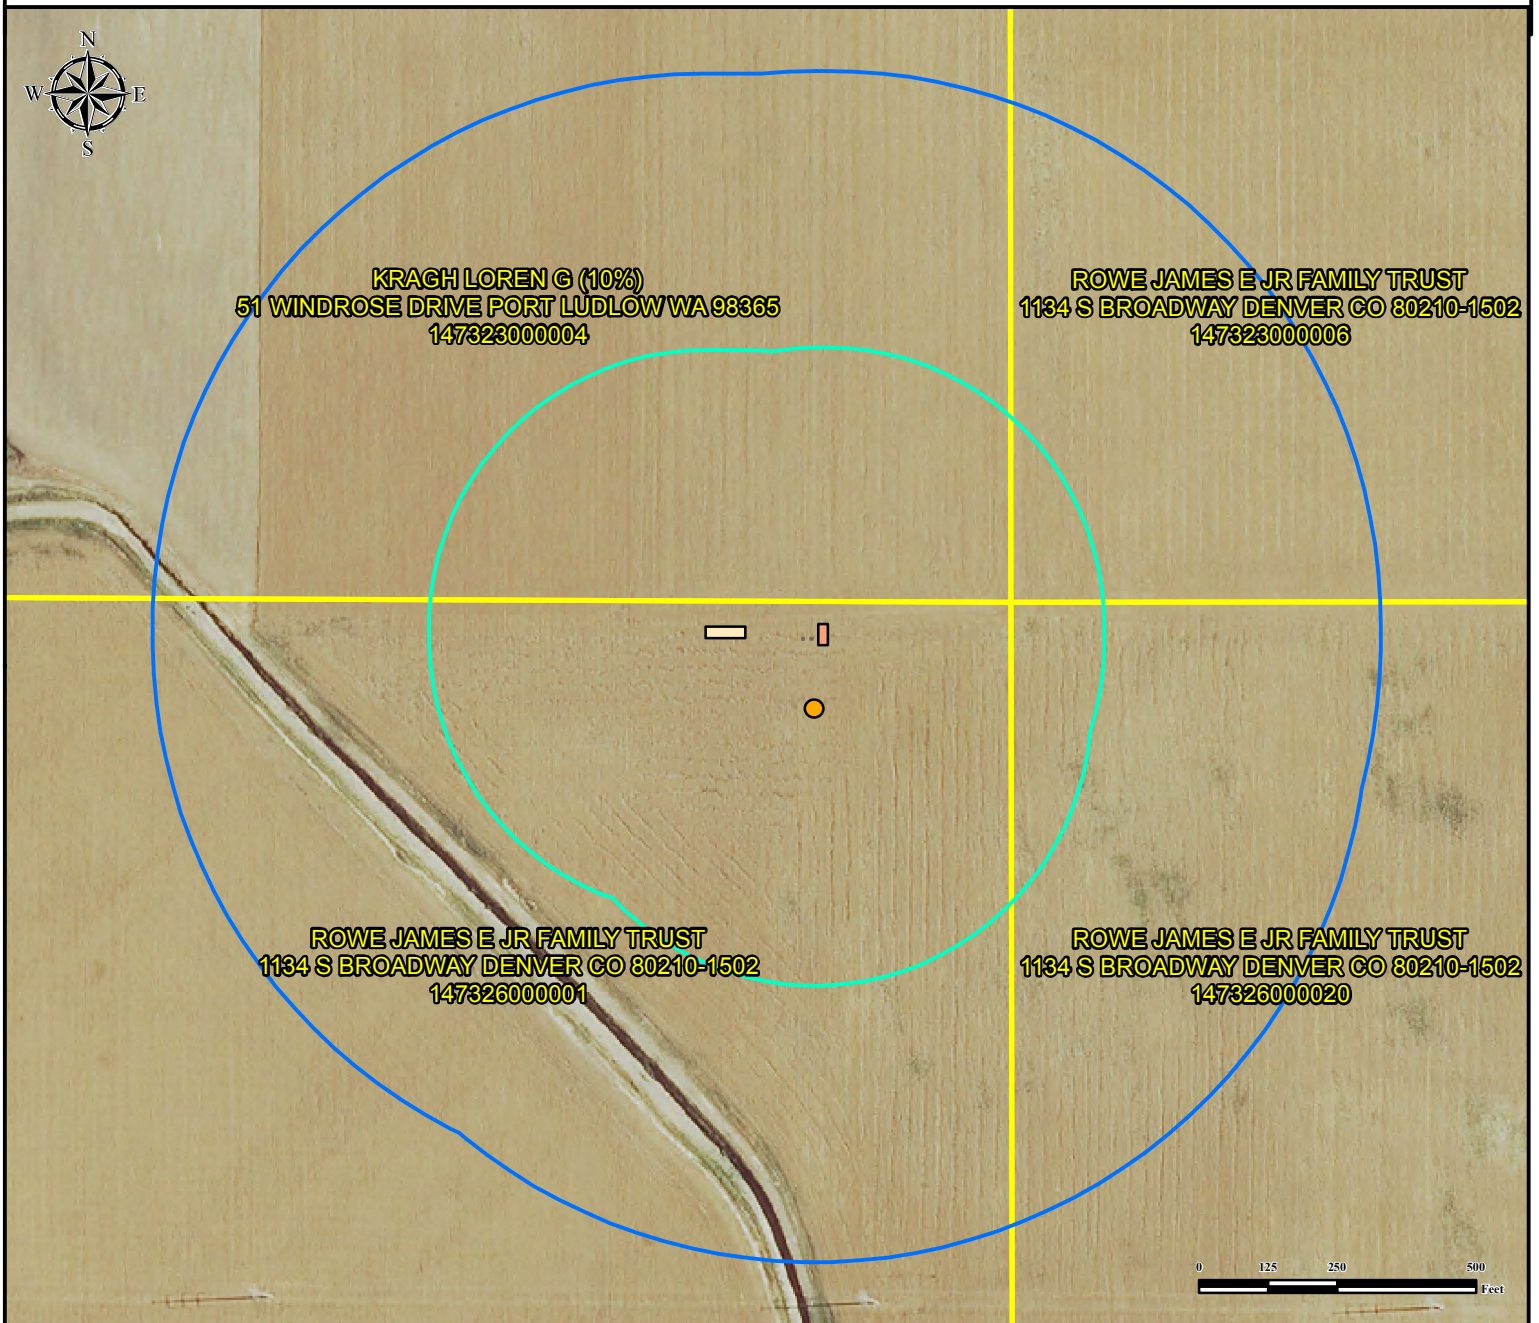

### Exception Zone

There are no building units within the Exception Zone.

### Buffer Zone

There are no building units within the Buffer Zone.

### Legend

- Proposed Well
- 500' Exception Zone
- 1000' Buffer Zone
- Parcels
- Proposed Separator Pad
- Proposed Tank Battery
- ECD

### Reference Location

All measurements are made from the wall or corner of the nearest Building Unit and the center of the proposed or existing wellhead closest to said Building Unit.



Use our resources to find yours!  
[www.petro-fs.com](http://www.petro-fs.com)  
 (303) 928-7128

Drafting Date: 1/16/2015  
 Drafted by: DRF  
 Checked by: FMB  
 Revision: 1

Data Sources:  
 - Aerial courtesy of  
 NAIP (2013)

Prepared for:

