

P.O. Box 356
Rangely, Colorado 81648

№ 24005

Date 8-5-19

P.O. No. _____

MIT test, recorded on crystal gauge
+ emailed to Andy

TOTAL

TOTAL INVOICE AMOUNT	385	00
----------------------	-----	----

Approved by _____


Larry

by Larry W. Christian

Data Collection Report

	Chassis	Left Scale	Right Scale
Serial Number	479180	477666	
Datatype		Lower	
Units		PSI G	

Lower

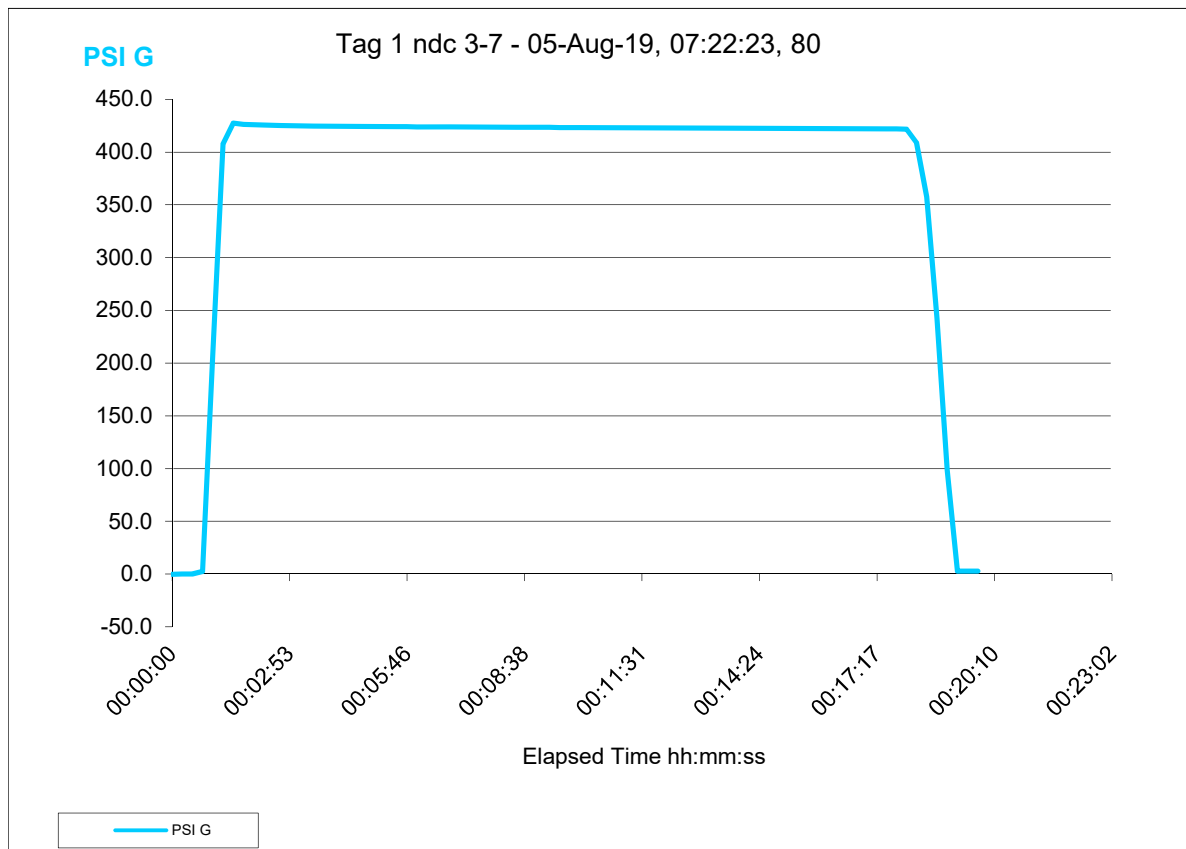

	Chassis	Lower Module	Upper Module	BARO Module	Left Scale	Right Scale
Serial Number	479180	477666			477666	
Model	NV	3KPSI				
Message Store						
Userspan		1.00000				
Offset						
Datatype					Lower	
Units		PSI G			PSI G	
Tare						
Average						
User Factor						
User Offset						
User Resolution						
Firmware Version	R080016	R090009				
Calibration Due		16-Jun-18				
Run Index	8					
Run Start Time				5-Aug-19/07:22:23		
Run Duration				19 minutes 45 seconds		
Run Tag				Tag 1 ndc 3-7		
Logging Interval	15.0					

Data Points		
Point #	Time	Left - PSI G
1	00:00:00.0	-0.1
2	00:00:15.0	0.0
3	00:00:30.0	0.0
4	00:00:45.0	2.6
5	00:01:00.0	208.4
6	00:01:15.0	407.8
7	00:01:30.0	427.4
8	00:01:45.0	426.2
9	00:02:00.0	426.1
10	00:02:15.0	425.7
11	00:02:30.0	425.5
12	00:02:45.0	425.2
13	00:03:00.0	424.9
14	00:03:15.0	424.9
15	00:03:30.0	424.8
16	00:03:45.0	424.7
17	00:04:00.0	424.6
18	00:04:15.0	424.5
19	00:04:30.0	424.4
20	00:04:45.0	424.3
21	00:05:00.0	424.3
22	00:05:15.0	424.2
23	00:05:30.0	424.2
24	00:05:45.0	424.1
25	00:06:00.0	424.0
26	00:06:15.0	424.0
27	00:06:30.0	424.0
28	00:06:45.0	423.8
29	00:07:00.0	423.8
30	00:07:15.0	423.8
31	00:07:30.0	423.7
32	00:07:45.0	423.7
33	00:08:00.0	423.6
34	00:08:15.0	423.6
35	00:08:30.0	423.5
36	00:08:45.0	423.5
37	00:09:00.0	423.5
38	00:09:15.0	423.4
39	00:09:30.0	423.3
40	00:09:45.0	423.3
41	00:10:00.0	423.2
42	00:10:15.0	423.2
43	00:10:30.0	423.1
44	00:10:45.0	423.1
45	00:11:00.0	423.1
46	00:11:15.0	423.0
47	00:11:30.0	423.0
48	00:11:45.0	422.9
49	00:12:00.0	422.9
50	00:12:15.0	422.8
51	00:12:30.0	422.8
52	00:12:45.0	422.8
53	00:13:00.0	422.7
54	00:13:15.0	422.7
55	00:13:30.0	422.6
56	00:13:45.0	422.6
57	00:14:00.0	422.5
58	00:14:15.0	422.5
59	00:14:30.0	422.5
60	00:14:45.0	422.5
61	00:15:00.0	422.4
62	00:15:15.0	422.4
63	00:15:30.0	422.3
64	00:15:45.0	422.3
65	00:16:00.0	422.3
66	00:16:15.0	422.2
67	00:16:30.0	422.1
68	00:16:45.0	422.2
69	00:17:00.0	422.1
70	00:17:15.0	422.0
71	00:17:30.0	422.0
72	00:17:45.0	422.0
73	00:18:00.0	421.8
74	00:18:15.0	409.0
75	00:18:30.0	357.4
76	00:18:45.0	242.8
77	00:19:00.0	98.8
78	00:19:15.0	2.7
79	00:19:30.0	2.7
80	00:19:45.0	2.7