


# SAKATA FEDERAL 8-6A -- 05-123-20740 -- Aqueous pH Chart

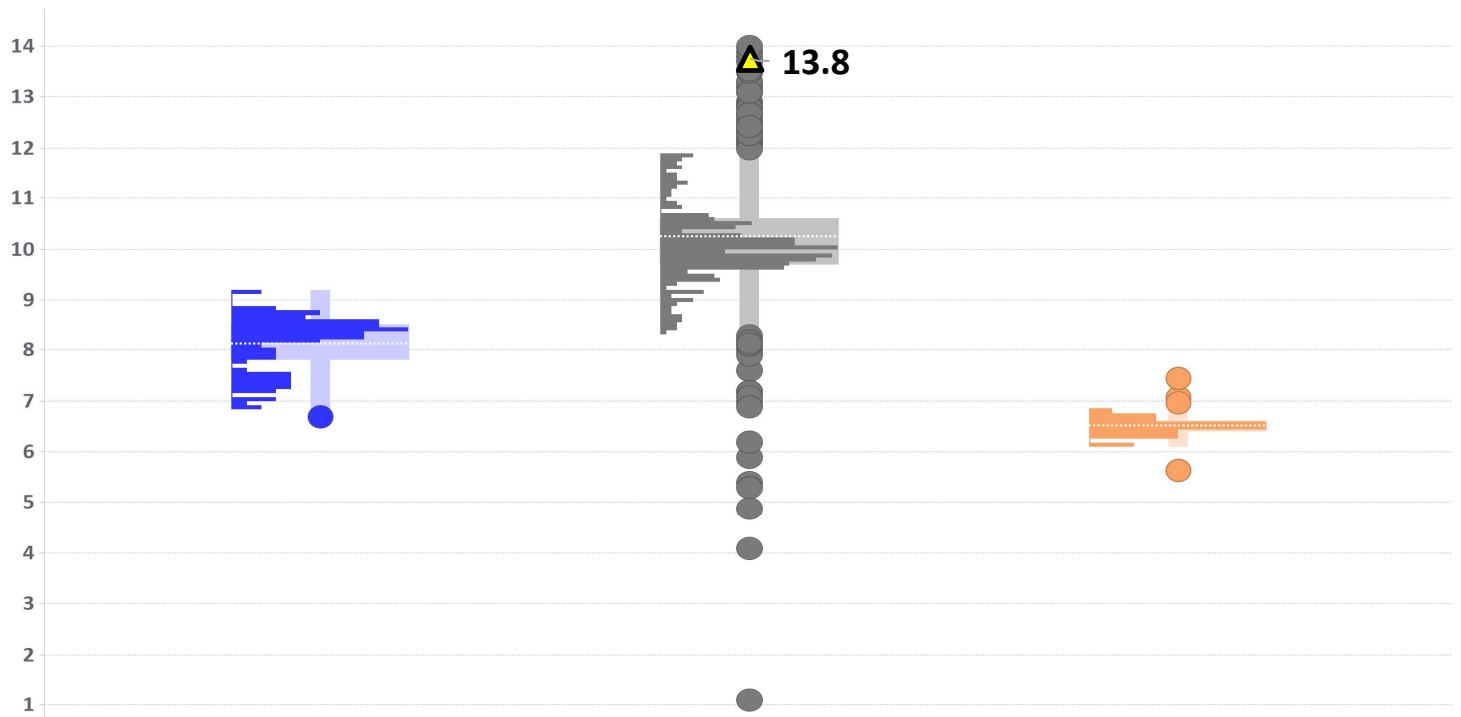

	Baseline Water Quality Aquifer Sample	Bradenhead Water Sample	Production Water Sample
Count	111	470	74
Outliers	1	86	8
Avg	8.13342	10.2491	6.52339

**BRADENHEAD WATER SAMPLE OBTAINED 11/06/19 pH 13.82 NOT INDICATIVE OF AQUIFER WATER**