


BALLANTINE 3-30 -- 05-123-23298 -- Aqueous pH Chart

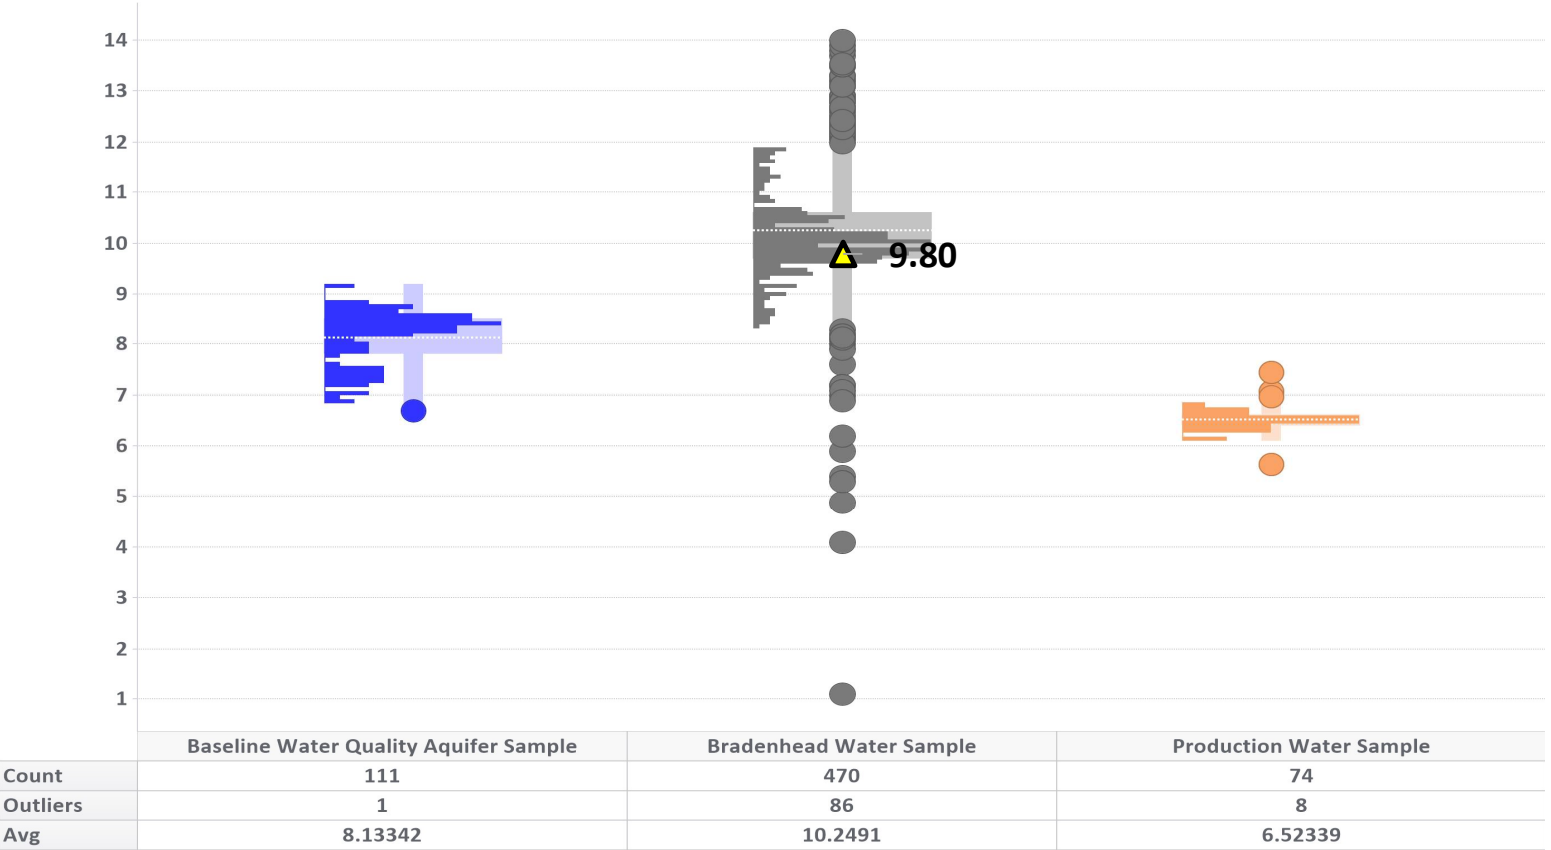

BRADENHEAD WATER SAMPLE OBTAINED 10/21/19 pH 9.80