


HSR-BEDDO 3-25 -- 05-123-19539 -- Aqueous pH Chart

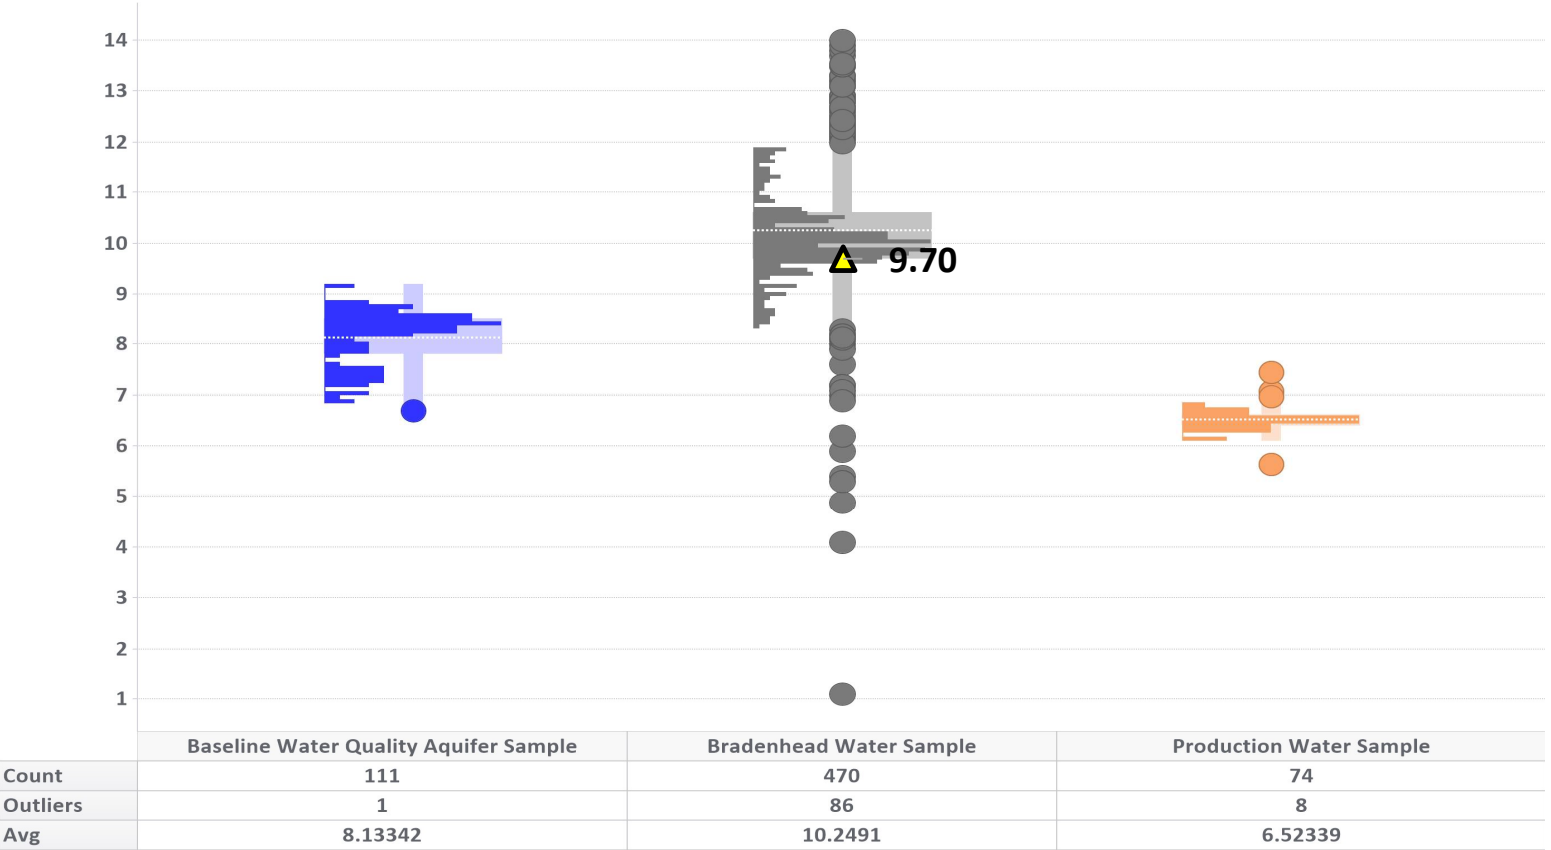

BRADENHEAD WATER SAMPLE OBTAINED 02/04/20 pH 9.70