


# MARTINDALE STATE 7-36 -- 05-123-21793 -- Aqueous pH Chart

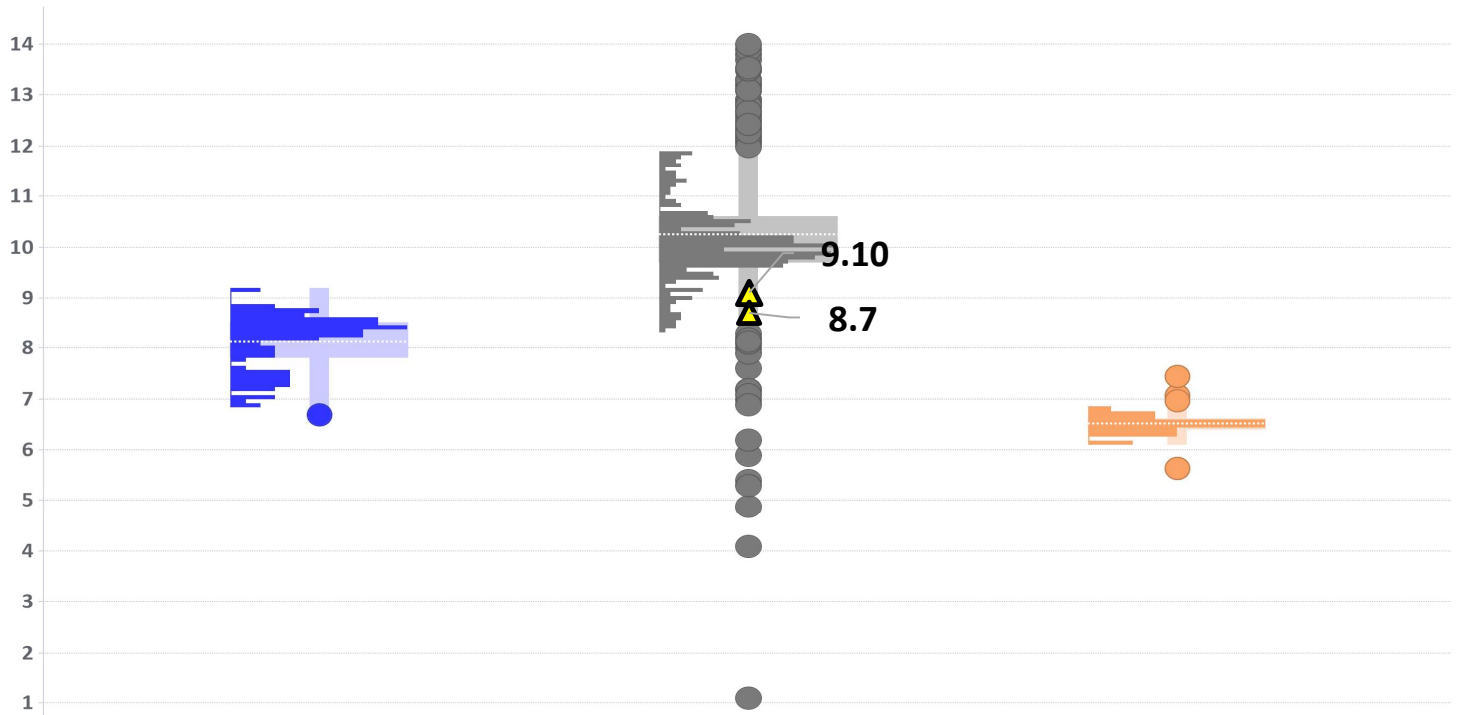

**BRADENHEAD WATER SAMPLE OBTAINED 11/18/20, 11/14/19 pH 9.1, 8.7, RESPECTIVELY**